


RIVmeter

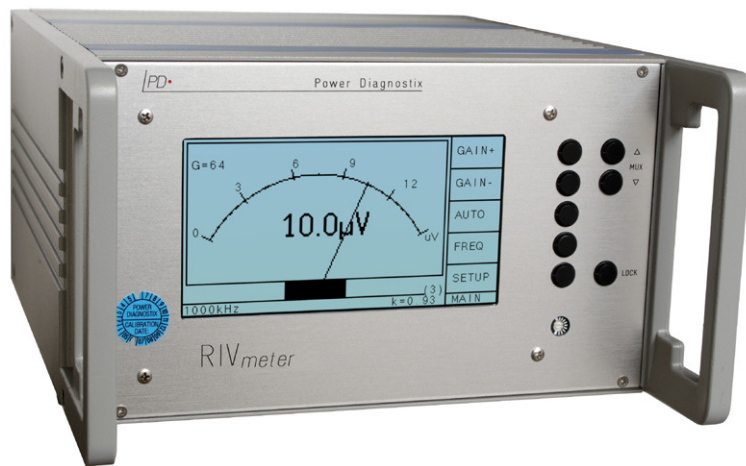

RIVmeter - Radio Influence Voltage Meter

Instruments

The RIVmeter is an instrument for the measurement of 'Radio Influence Voltage' according to the relevant standards (NEMA 107-1987, ANSI 63-2-1996, VDE 876, DIN EN 55016-1-1). The instrument has a bandwidth of 9 kHz and a tunable center frequency of 10kHz - 10MHz. Technically, the RIVmeter is a selective μV -meter. However, the meter reading is weighted according to the CISPRE weighting curve, whereas the repetition rate has a strong impact on the reading. The RIVmeter is an ideal instrument to replace outdated RIV measurement instruments in a transformer testing lab, for instance.

Some routine PD measurements are still done according IEEE Standards requiring the measurement of 'RIV' (RIV = Radio Influence Voltage). The RIV value is given in μV (interference voltage). A 'narrow band' filter performs a quasi-integration of the PD pulses with a quasi-peak detection at the center frequency. This center frequency can be adjusted between 10kHz and 10MHz. The narrow-band pass filter allows to suppress external noise e.g. in non-shielded laboratories by varying the center frequency of the filter.

Two factors determine the RIV in μV : The transferred charge and the repetition rate of the PD impulse (number of PD pulses per second). Because of this proceed-


ing, a direct translation of the measured RIV values (μV) into values of apparent charge in pC is not possible .

New RIVmeter supporting old standards

Historically, the RIV technique is based on measurement receivers to estimate the disturbance of communication lines. Thus, properties of those instruments then available became part of the NEMA standards. However, both the 9kHz bandwidth and the CISPRE weighting curve put emphasis on some partial discharge activity, while they tend hiding others.

The calibration of the RIV measurement is done using an RIV calibrator, injecting a sine wave of typically 100 μ V into the bushing. The multiplexer of the RIVmeter is used to conveniently determine the correction factor according to NEMA 107-1987 and other standards. Here, the unit compares the voltage injected, i.e., loaded by the bushing's impedance, with the voltage detected at the bushing tap to auto-

atically determine the k-factor. This correction factor is then stored independently for each channel during calibration. The standard calibrator for RIV calibration, CAL3A, offers a selectable frequency range of 600-1350kHz in steps of 50kHz. The output voltage covers 10 μ V to 10mV in 1-2-5 steps. The CAL3B calibrator offers a frequency range of 400kHz to 1.9MHz with the same output voltage but in steps of 100kHz.

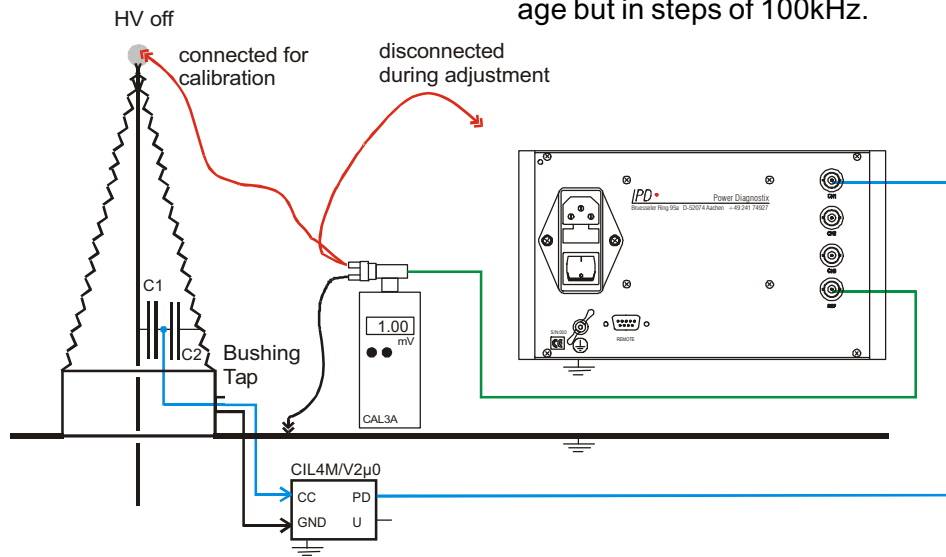

Old Stoddart NM-25T



Old Siemens B83600-B40



CAL3A for RIV calibration



RIVmeter rear panel

The RIVmeter is an instrument for the measurement of 'Radio Influence Voltage' according to NEMA 107-1987 and other relevant standards. It is the ideal instrument to replace outdated RIV measurement instruments in a transformer testing lab.

© Power Diagnostix 2008

Power Diagnostix Systems GmbH
Brüsseler Ring 95a
52074 Aachen
Germany

Email: support@pdix.com
Web Site: www.pdix.com
Tel: + 49 241 74927
Fax: + 49 241 79521